



GERAND ENGINEERING

2300 EDGEWOOD AVE S, MINNEAPOLIS MN 55426
952.374.1320 WWW.GERAND.COM

FIRE PUMP TEST METER K-4000-12

CONSTRUCTION & SPECIFICATIONS

MATERIALS: CA36 ASTM B16 BRASS

VALVES: RATED AT 600 WOG
VALVE BODY: CAST BRONZE ASTM B584
TAIL PIECE: CA-360 B-16
BALL: BRASS CA-360 HARD CHROME P
LATED SEALS: REINFORCED PTFE, 15%
GLASS FILLED HANDLE: STEEL ASTM B633
W/ZINC PLATING

BRASS FITTING: PIPE NIPPLE - B16 / 1/8" NEEDLEVALVE-B16
DISCONNECTS-B16

ID TAG: CHAIN: BRASS
TAG: ALUMINUM -3.21" THICK #200 MILL
SET SCREW: STEEL ZINC PLATED

HOSES: GOODYEAR 3/16" FREON CHARGING HOSES
WITH NYTRIEE CORE, POLYESTER BRAID
AND NYTRILE COVER WITH PVC
FOR ABRASION RESISTANCE.

METER DATA

CONSTRUCTION: ALUMINUM BODY

OPERATION: BUNA "N" DIAPHRAGM


ACCURACY: ±2.0%

TEMPERATURE: 200° F MAX

PRESSURE: 1500 PSI MAX

APPROX. WEIGHT: 3 LBS/EACH

4 1/2" DIAL STANDARD - 6" AVAILABLE

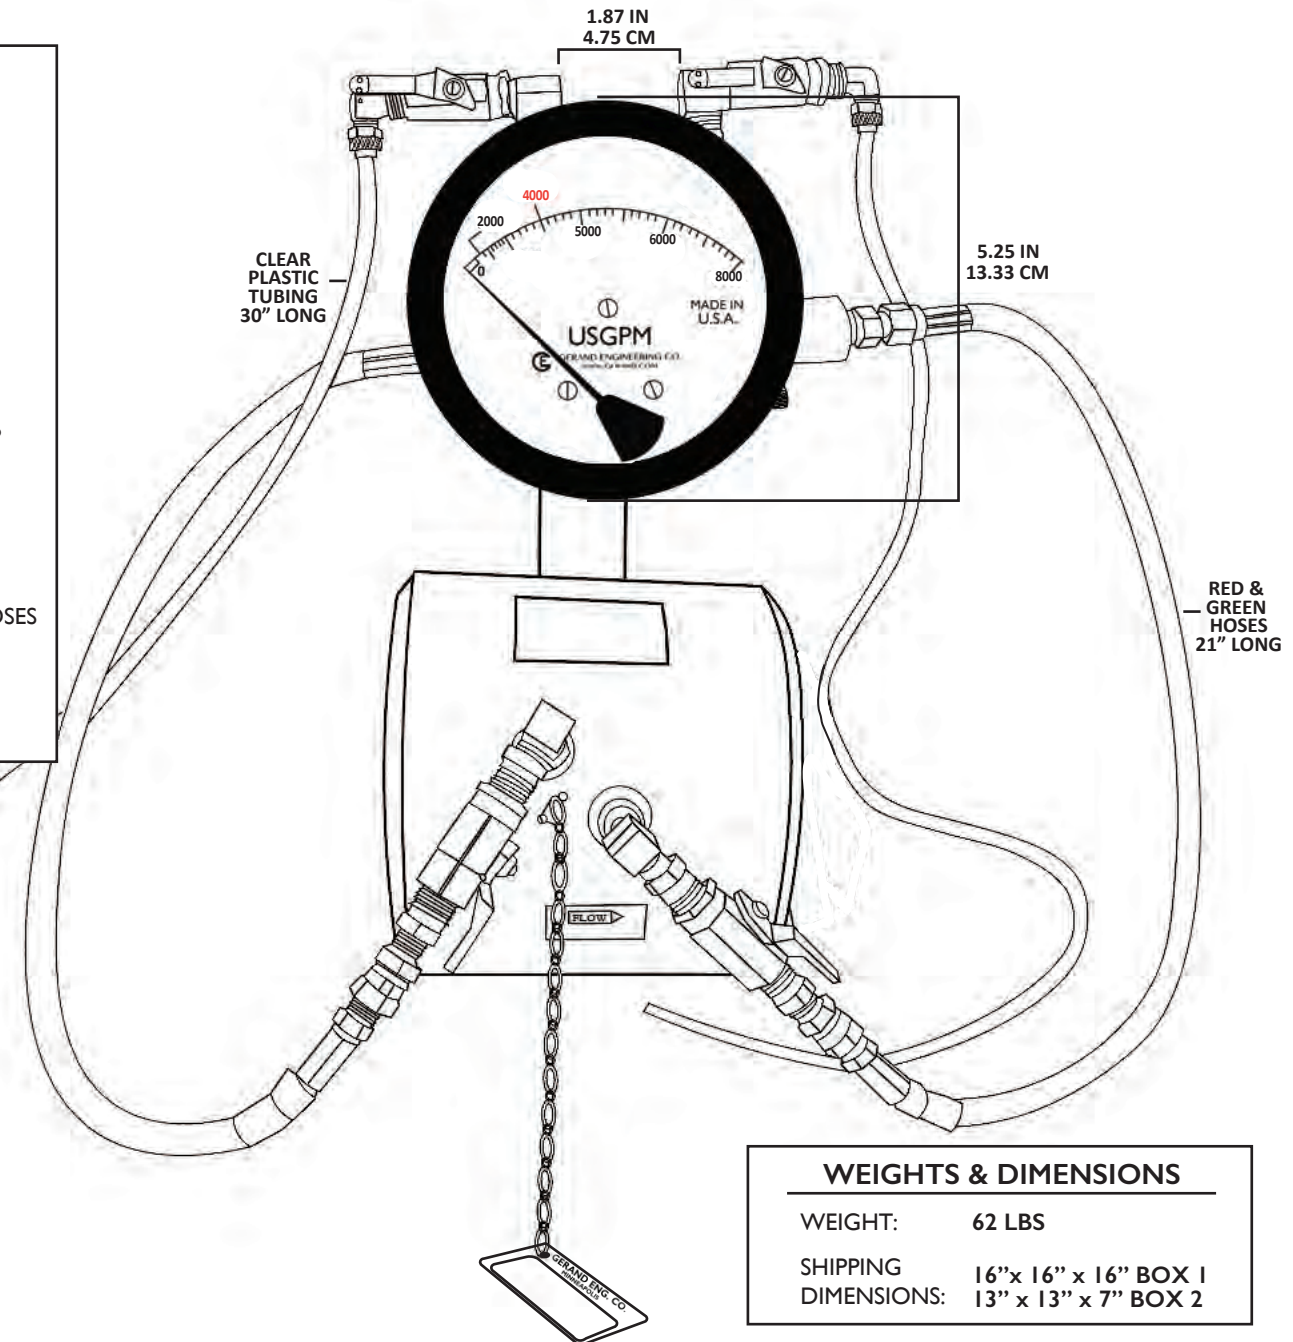

WEIGHTS & DIMENSIONS

WEIGHT: 62 LBS

SHIPPING DIMENSIONS: 16" x 16" x 16" BOX 1
13" x 13" x 7" BOX 2