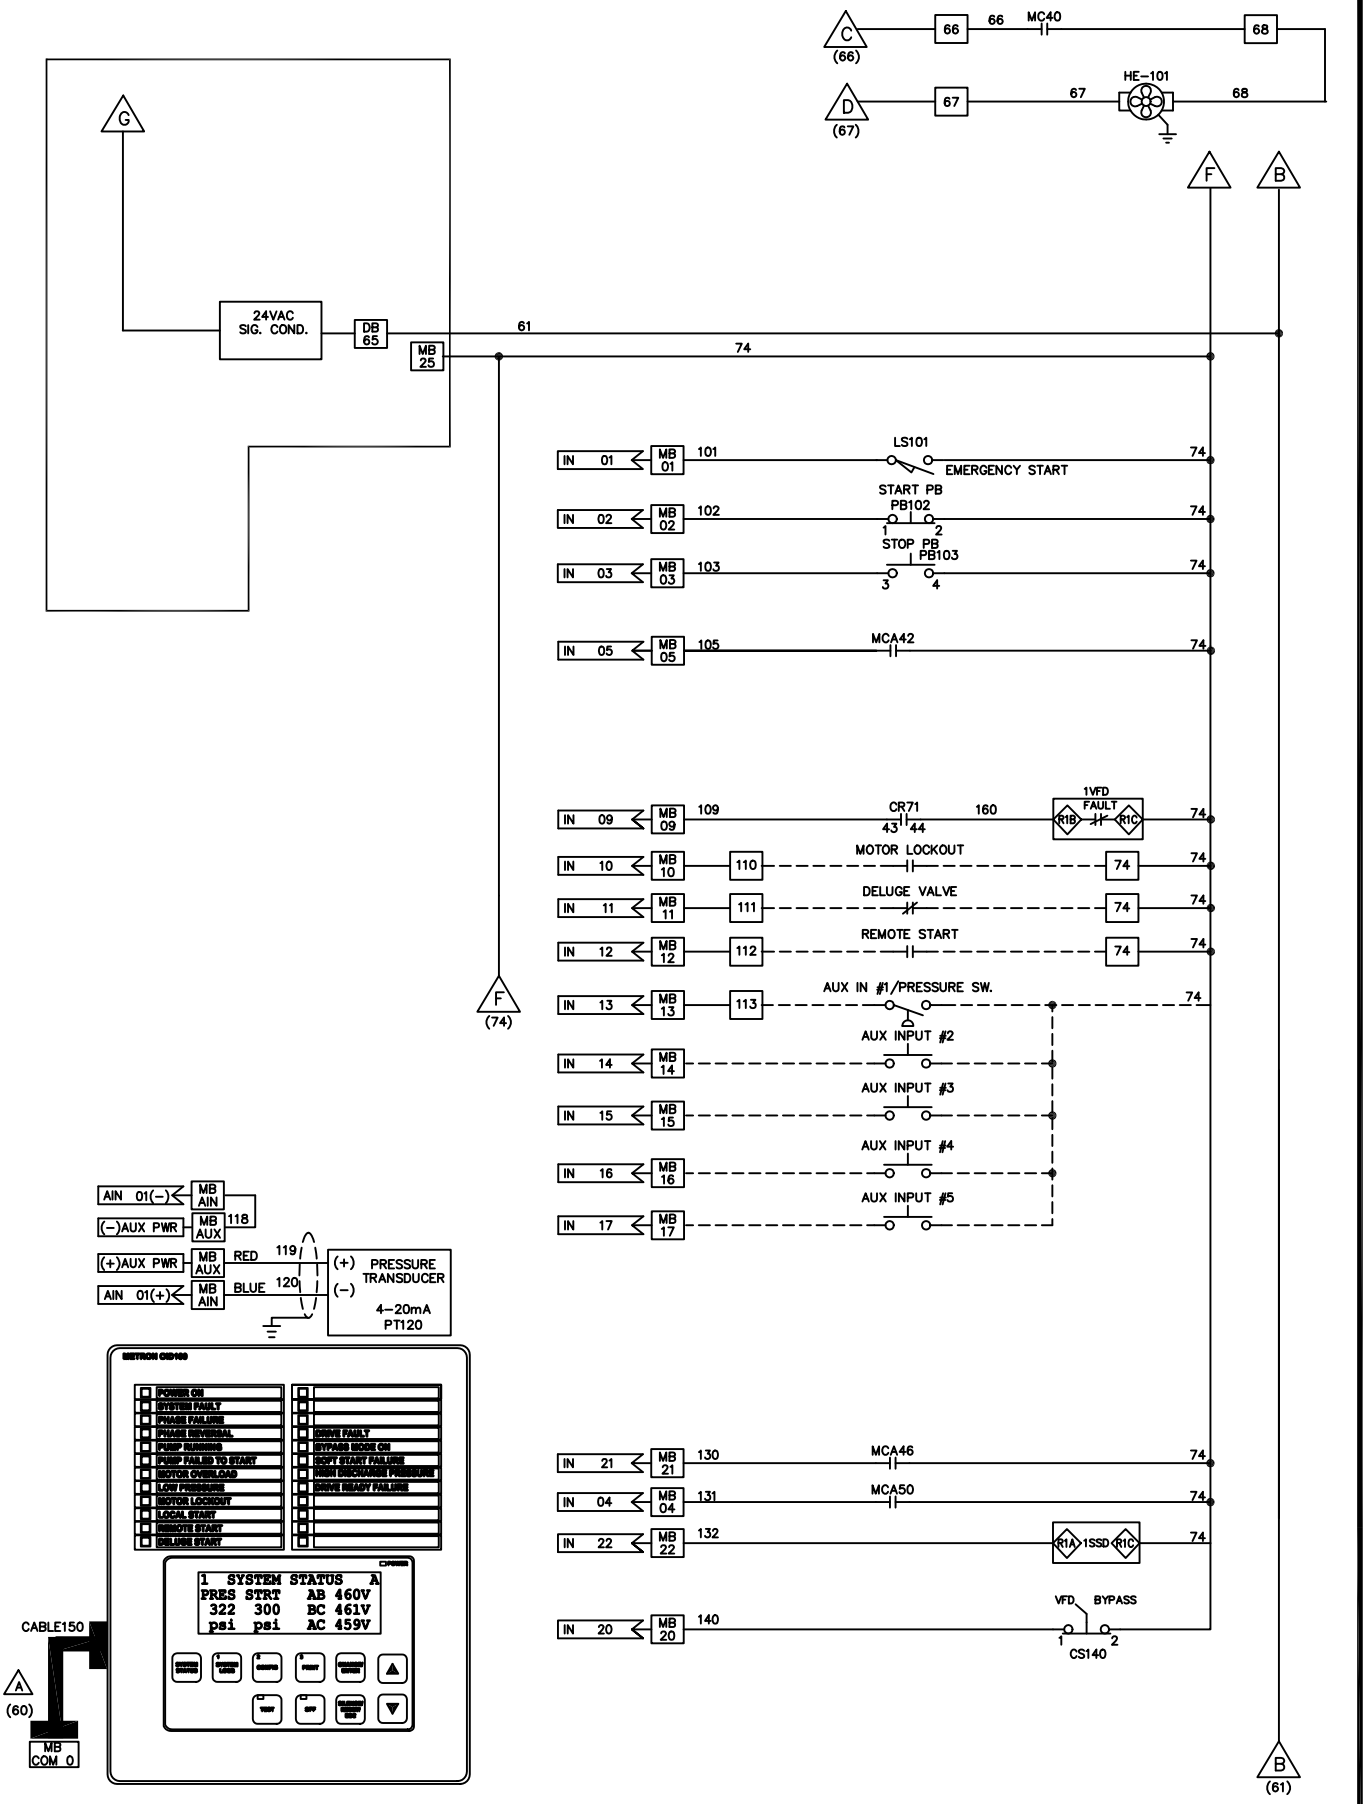

LEGEND:

MB ## – MB = MB100 MOTHERBOARD I/O TERMINAL

DB ## – DB = DB200 DAUGHTERBOARD I/O TERMINAL

(1) – WIRES OR TERMINALS LOCATED ON CIRCUIT BREAKER

	DRAWN M.A. 02-14-06	METRON, INC. DENVER, CO.
	CHECK	
	APPD M.K. 03-24-07	
SCHEMATIC, MODEL MP800 VARIABLE FREQUENCY DRIVE ELECTRIC FPC W/SOFT START BYPASS		OPTIONS: H
		CS34081A
	SCALE NTS	SHEET 2 OF 3